

JIL5004 : 2021 (2022 年版) 公共施設用照明器具 正誤表

2023 年 1 月 16 日
(一社)日本照明工業会

頁	対 象	誤	正																																																																																																																																																																																																																																									
P35	表 A.5－LED 照明器具 の最大器具取付間隔及 び固有照明率（続き） 規格値の訂正-1	LRS20-4-37,48,65 <table><tr><th rowspan="3">最大器具 取付間隔 (Lm)</th><th rowspan="3">反射率 (%) 室指数</th><th>天井</th><th colspan="3">70</th><th colspan="2">50</th><th>30</th><th>0</th></tr><tr><th>壁</th><th>70</th><th>50</th><th>30</th><th>50</th><th>30</th><th>30</th><th>0</th></tr><tr><th>床</th><th colspan="3">10</th><th colspan="2">10</th><th>10</th><th>0</th></tr><tr><td rowspan="10">Lm(0-A)=1.20H Lm(0-B)=1.20H</td><td>0.60</td><td>J</td><td>0.53</td><td>0.41</td><td>0.33</td><td>0.40</td><td>0.33</td><td>0.32</td><td>0.27</td></tr><tr><td>0.80</td><td>I</td><td>0.62</td><td>0.50</td><td>0.43</td><td>0.49</td><td>0.42</td><td>0.42</td><td>0.36</td></tr><tr><td>1.00</td><td>H</td><td>0.70</td><td>0.59</td><td>0.51</td><td>0.57</td><td>0.50</td><td>0.50</td><td>0.44</td></tr><tr><td>1.25</td><td>G</td><td>0.76</td><td>0.66</td><td>0.58</td><td>0.64</td><td>0.58</td><td>0.57</td><td>0.51</td></tr><tr><td>1.50</td><td>F</td><td>0.80</td><td>0.71</td><td>0.65</td><td>0.70</td><td>0.64</td><td>0.63</td><td>0.57</td></tr><tr><td>2.00</td><td>E</td><td>0.86</td><td>0.78</td><td>0.73</td><td>0.77</td><td>0.72</td><td>0.71</td><td>0.65</td></tr><tr><td>2.50</td><td>D</td><td>0.89</td><td>0.83</td><td>0.79</td><td>0.81</td><td>0.78</td><td>0.76</td><td>0.70</td></tr><tr><td>3.00</td><td>C</td><td>0.93</td><td>0.87</td><td>0.82</td><td>0.85</td><td>0.81</td><td>0.80</td><td>0.74</td></tr><tr><td>4.00</td><td>B</td><td>0.96</td><td>0.92</td><td>0.88</td><td>0.89</td><td>0.86</td><td>0.85</td><td>0.80</td></tr><tr><td>5.00</td><td>A</td><td>0.97</td><td>0.94</td><td>0.92</td><td>0.92</td><td>0.89</td><td>0.88</td><td>0.83</td></tr></table>	最大器具 取付間隔 (Lm)	反射率 (%) 室指数	天井	70			50		30	0	壁	70	50	30	50	30	30	0	床	10			10		10	0	Lm(0-A)=1.20H Lm(0-B)=1.20H	0.60	J	0.53	0.41	0.33	0.40	0.33	0.32	0.27	0.80	I	0.62	0.50	0.43	0.49	0.42	0.42	0.36	1.00	H	0.70	0.59	0.51	0.57	0.50	0.50	0.44	1.25	G	0.76	0.66	0.58	0.64	0.58	0.57	0.51	1.50	F	0.80	0.71	0.65	0.70	0.64	0.63	0.57	2.00	E	0.86	0.78	0.73	0.77	0.72	0.71	0.65	2.50	D	0.89	0.83	0.79	0.81	0.78	0.76	0.70	3.00	C	0.93	0.87	0.82	0.85	0.81	0.80	0.74	4.00	B	0.96	0.92	0.88	0.89	0.86	0.85	0.80	5.00	A	0.97	0.94	0.92	0.92	0.89	0.88	0.83	LRS20-4-37,48,65 <table><tr><th rowspan="3">室指数</th><th rowspan="3">反射率 (%)</th><th>天井</th><th colspan="3">70</th><th colspan="2">50</th><th>30</th><th>0</th></tr><tr><th>壁</th><th>70</th><th>50</th><th>30</th><th>50</th><th>30</th><th>30</th><th>0</th></tr><tr><th>床</th><th colspan="3">10</th><th colspan="2">10</th><th>10</th><th>0</th></tr><tr><td>0.60</td><td>J</td><td>0.53</td><td>0.41</td><td>0.33</td><td>0.40</td><td>0.33</td><td>0.32</td><td>0.27</td></tr><tr><td>0.80</td><td>I</td><td>0.62</td><td>0.50</td><td>0.43</td><td>0.49</td><td>0.42</td><td>0.42</td><td>0.36</td></tr><tr><td>1.00</td><td>H</td><td>0.70</td><td>0.59</td><td>0.51</td><td>0.57</td><td>0.50</td><td>0.50</td><td>0.44</td></tr><tr><td>1.25</td><td>G</td><td>0.76</td><td>0.66</td><td>0.58</td><td>0.64</td><td>0.58</td><td>0.57</td><td>0.51</td></tr><tr><td>1.50</td><td>F</td><td>0.80</td><td>0.71</td><td>0.65</td><td>0.70</td><td>0.64</td><td>0.63</td><td>0.56</td></tr><tr><td>2.00</td><td>E</td><td>0.86</td><td>0.78</td><td>0.73</td><td>0.77</td><td>0.72</td><td>0.71</td><td>0.64</td></tr><tr><td>2.50</td><td>D</td><td>0.89</td><td>0.83</td><td>0.79</td><td>0.81</td><td>0.77</td><td>0.76</td><td>0.70</td></tr><tr><td>3.00</td><td>C</td><td>0.93</td><td>0.87</td><td>0.82</td><td>0.85</td><td>0.81</td><td>0.80</td><td>0.74</td></tr><tr><td>4.00</td><td>B</td><td>0.96</td><td>0.92</td><td>0.88</td><td>0.89</td><td>0.86</td><td>0.85</td><td>0.80</td></tr><tr><td>5.00</td><td>A</td><td>0.97</td><td>0.94</td><td>0.92</td><td>0.92</td><td>0.89</td><td>0.88</td><td>0.83</td></tr></table>	室指数	反射率 (%)	天井	70			50		30	0	壁	70	50	30	50	30	30	0	床	10			10		10	0	0.60	J	0.53	0.41	0.33	0.40	0.33	0.32	0.27	0.80	I	0.62	0.50	0.43	0.49	0.42	0.42	0.36	1.00	H	0.70	0.59	0.51	0.57	0.50	0.50	0.44	1.25	G	0.76	0.66	0.58	0.64	0.58	0.57	0.51	1.50	F	0.80	0.71	0.65	0.70	0.64	0.63	0.56	2.00	E	0.86	0.78	0.73	0.77	0.72	0.71	0.64	2.50	D	0.89	0.83	0.79	0.81	0.77	0.76	0.70	3.00	C	0.93	0.87	0.82	0.85	0.81	0.80	0.74	4.00	B	0.96	0.92	0.88	0.89	0.86	0.85	0.80	5.00	A	0.97	0.94	0.92	0.92	0.89	0.88	0.83
最大器具 取付間隔 (Lm)	反射率 (%) 室指数	天井			70			50		30	0																																																																																																																																																																																																																																	
		壁			70	50	30	50	30	30	0																																																																																																																																																																																																																																	
		床	10			10		10	0																																																																																																																																																																																																																																			
Lm(0-A)=1.20H Lm(0-B)=1.20H	0.60	J	0.53	0.41	0.33	0.40	0.33	0.32	0.27																																																																																																																																																																																																																																			
	0.80	I	0.62	0.50	0.43	0.49	0.42	0.42	0.36																																																																																																																																																																																																																																			
	1.00	H	0.70	0.59	0.51	0.57	0.50	0.50	0.44																																																																																																																																																																																																																																			
	1.25	G	0.76	0.66	0.58	0.64	0.58	0.57	0.51																																																																																																																																																																																																																																			
	1.50	F	0.80	0.71	0.65	0.70	0.64	0.63	0.57																																																																																																																																																																																																																																			
	2.00	E	0.86	0.78	0.73	0.77	0.72	0.71	0.65																																																																																																																																																																																																																																			
	2.50	D	0.89	0.83	0.79	0.81	0.78	0.76	0.70																																																																																																																																																																																																																																			
	3.00	C	0.93	0.87	0.82	0.85	0.81	0.80	0.74																																																																																																																																																																																																																																			
	4.00	B	0.96	0.92	0.88	0.89	0.86	0.85	0.80																																																																																																																																																																																																																																			
	5.00	A	0.97	0.94	0.92	0.92	0.89	0.88	0.83																																																																																																																																																																																																																																			
室指数	反射率 (%)	天井	70			50		30	0																																																																																																																																																																																																																																			
		壁	70	50	30	50	30	30	0																																																																																																																																																																																																																																			
		床	10			10		10	0																																																																																																																																																																																																																																			
0.60	J	0.53	0.41	0.33	0.40	0.33	0.32	0.27																																																																																																																																																																																																																																				
0.80	I	0.62	0.50	0.43	0.49	0.42	0.42	0.36																																																																																																																																																																																																																																				
1.00	H	0.70	0.59	0.51	0.57	0.50	0.50	0.44																																																																																																																																																																																																																																				
1.25	G	0.76	0.66	0.58	0.64	0.58	0.57	0.51																																																																																																																																																																																																																																				
1.50	F	0.80	0.71	0.65	0.70	0.64	0.63	0.56																																																																																																																																																																																																																																				
2.00	E	0.86	0.78	0.73	0.77	0.72	0.71	0.64																																																																																																																																																																																																																																				
2.50	D	0.89	0.83	0.79	0.81	0.77	0.76	0.70																																																																																																																																																																																																																																				
3.00	C	0.93	0.87	0.82	0.85	0.81	0.80	0.74																																																																																																																																																																																																																																				
4.00	B	0.96	0.92	0.88	0.89	0.86	0.85	0.80																																																																																																																																																																																																																																				
5.00	A	0.97	0.94	0.92	0.92	0.89	0.88	0.83																																																																																																																																																																																																																																				
P38	規格値の訂正-2	LSS15-4-41,58,80 LSS15-7-58,80 <table><tr><th rowspan="3">最大器具 取付間隔 (Lm)</th><th rowspan="3">反射率 (%) 室指数</th><th>天井</th><th colspan="3">70</th><th colspan="2">50</th><th>30</th><th>0</th></tr><tr><th>壁</th><th>70</th><th>50</th><th>30</th><th>50</th><th>30</th><th>30</th><th>0</th></tr><tr><th>床</th><th colspan="3">10</th><th colspan="2">10</th><th>10</th><th>0</th></tr><tr><td rowspan="10">Lm(0-A)=1.20H Lm(0-B)=1.20H</td><td>0.60</td><td>J</td><td>0.52</td><td>0.40</td><td>0.34</td><td>0.39</td><td>0.33</td><td>0.33</td><td>0.29</td></tr><tr><td>0.80</td><td>I</td><td>0.59</td><td>0.49</td><td>0.41</td><td>0.47</td><td>0.40</td><td>0.39</td><td>0.37</td></tr><tr><td>1.00</td><td>H</td><td>0.66</td><td>0.57</td><td>0.49</td><td>0.55</td><td>0.48</td><td>0.47</td><td>0.44</td></tr><tr><td>1.25</td><td>G</td><td>0.73</td><td>0.63</td><td>0.57</td><td>0.61</td><td>0.56</td><td>0.55</td><td>0.51</td></tr><tr><td>1.50</td><td>F</td><td>0.76</td><td>0.68</td><td>0.61</td><td>0.66</td><td>0.60</td><td>0.58</td><td>0.56</td></tr><tr><td>2.00</td><td>E</td><td>0.81</td><td>0.75</td><td>0.69</td><td>0.73</td><td>0.68</td><td>0.66</td><td>0.65</td></tr><tr><td>2.50</td><td>D</td><td>0.85</td><td>0.79</td><td>0.75</td><td>0.77</td><td>0.73</td><td>0.71</td><td>0.70</td></tr><tr><td>3.00</td><td>C</td><td>0.88</td><td>0.83</td><td>0.78</td><td>0.80</td><td>0.76</td><td>0.75</td><td>0.74</td></tr><tr><td>4.00</td><td>B</td><td>0.91</td><td>0.87</td><td>0.83</td><td>0.84</td><td>0.81</td><td>0.79</td><td>0.78</td></tr><tr><td>5.00</td><td>A</td><td>0.93</td><td>0.90</td><td>0.86</td><td>0.87</td><td>0.84</td><td>0.82</td><td>0.81</td></tr></table>	最大器具 取付間隔 (Lm)	反射率 (%) 室指数	天井	70			50		30	0	壁	70	50	30	50	30	30	0	床	10			10		10	0	Lm(0-A)=1.20H Lm(0-B)=1.20H	0.60	J	0.52	0.40	0.34	0.39	0.33	0.33	0.29	0.80	I	0.59	0.49	0.41	0.47	0.40	0.39	0.37	1.00	H	0.66	0.57	0.49	0.55	0.48	0.47	0.44	1.25	G	0.73	0.63	0.57	0.61	0.56	0.55	0.51	1.50	F	0.76	0.68	0.61	0.66	0.60	0.58	0.56	2.00	E	0.81	0.75	0.69	0.73	0.68	0.66	0.65	2.50	D	0.85	0.79	0.75	0.77	0.73	0.71	0.70	3.00	C	0.88	0.83	0.78	0.80	0.76	0.75	0.74	4.00	B	0.91	0.87	0.83	0.84	0.81	0.79	0.78	5.00	A	0.93	0.90	0.86	0.87	0.84	0.82	0.81	LSS15-4-41,58,80 LSS15-7-58,80 <table><tr><th rowspan="3">室指数</th><th rowspan="3">反射率 (%)</th><th>天井</th><th colspan="3">70</th><th colspan="2">50</th><th>30</th><th>0</th></tr><tr><th>壁</th><th>70</th><th>50</th><th>30</th><th>50</th><th>30</th><th>30</th><th>0</th></tr><tr><th>床</th><th colspan="3">10</th><th colspan="2">10</th><th>10</th><th>0</th></tr><tr><td>0.60</td><td>J</td><td>0.52</td><td>0.40</td><td>0.34</td><td>0.39</td><td>0.33</td><td>0.33</td><td>0.26</td></tr><tr><td>0.80</td><td>I</td><td>0.59</td><td>0.49</td><td>0.41</td><td>0.47</td><td>0.40</td><td>0.39</td><td>0.37</td></tr><tr><td>1.00</td><td>H</td><td>0.66</td><td>0.57</td><td>0.49</td><td>0.55</td><td>0.48</td><td>0.47</td><td>0.44</td></tr><tr><td>1.25</td><td>G</td><td>0.73</td><td>0.63</td><td>0.57</td><td>0.61</td><td>0.56</td><td>0.55</td><td>0.51</td></tr><tr><td>1.50</td><td>F</td><td>0.76</td><td>0.68</td><td>0.61</td><td>0.66</td><td>0.60</td><td>0.58</td><td>0.56</td></tr><tr><td>2.00</td><td>E</td><td>0.81</td><td>0.75</td><td>0.69</td><td>0.73</td><td>0.68</td><td>0.66</td><td>0.63</td></tr><tr><td>2.50</td><td>D</td><td>0.85</td><td>0.79</td><td>0.75</td><td>0.77</td><td>0.73</td><td>0.71</td><td>0.67</td></tr><tr><td>3.00</td><td>C</td><td>0.88</td><td>0.83</td><td>0.78</td><td>0.80</td><td>0.76</td><td>0.75</td><td>0.72</td></tr><tr><td>4.00</td><td>B</td><td>0.91</td><td>0.87</td><td>0.83</td><td>0.84</td><td>0.81</td><td>0.79</td><td>0.78</td></tr><tr><td>5.00</td><td>A</td><td>0.93</td><td>0.90</td><td>0.86</td><td>0.87</td><td>0.84</td><td>0.82</td><td>0.81</td></tr></table>	室指数	反射率 (%)	天井	70			50		30	0	壁	70	50	30	50	30	30	0	床	10			10		10	0	0.60	J	0.52	0.40	0.34	0.39	0.33	0.33	0.26	0.80	I	0.59	0.49	0.41	0.47	0.40	0.39	0.37	1.00	H	0.66	0.57	0.49	0.55	0.48	0.47	0.44	1.25	G	0.73	0.63	0.57	0.61	0.56	0.55	0.51	1.50	F	0.76	0.68	0.61	0.66	0.60	0.58	0.56	2.00	E	0.81	0.75	0.69	0.73	0.68	0.66	0.63	2.50	D	0.85	0.79	0.75	0.77	0.73	0.71	0.67	3.00	C	0.88	0.83	0.78	0.80	0.76	0.75	0.72	4.00	B	0.91	0.87	0.83	0.84	0.81	0.79	0.78	5.00	A	0.93	0.90	0.86	0.87	0.84	0.82	0.81
最大器具 取付間隔 (Lm)	反射率 (%) 室指数	天井			70			50		30	0																																																																																																																																																																																																																																	
		壁			70	50	30	50	30	30	0																																																																																																																																																																																																																																	
		床	10			10		10	0																																																																																																																																																																																																																																			
Lm(0-A)=1.20H Lm(0-B)=1.20H	0.60	J	0.52	0.40	0.34	0.39	0.33	0.33	0.29																																																																																																																																																																																																																																			
	0.80	I	0.59	0.49	0.41	0.47	0.40	0.39	0.37																																																																																																																																																																																																																																			
	1.00	H	0.66	0.57	0.49	0.55	0.48	0.47	0.44																																																																																																																																																																																																																																			
	1.25	G	0.73	0.63	0.57	0.61	0.56	0.55	0.51																																																																																																																																																																																																																																			
	1.50	F	0.76	0.68	0.61	0.66	0.60	0.58	0.56																																																																																																																																																																																																																																			
	2.00	E	0.81	0.75	0.69	0.73	0.68	0.66	0.65																																																																																																																																																																																																																																			
	2.50	D	0.85	0.79	0.75	0.77	0.73	0.71	0.70																																																																																																																																																																																																																																			
	3.00	C	0.88	0.83	0.78	0.80	0.76	0.75	0.74																																																																																																																																																																																																																																			
	4.00	B	0.91	0.87	0.83	0.84	0.81	0.79	0.78																																																																																																																																																																																																																																			
	5.00	A	0.93	0.90	0.86	0.87	0.84	0.82	0.81																																																																																																																																																																																																																																			
室指数	反射率 (%)	天井	70			50		30	0																																																																																																																																																																																																																																			
		壁	70	50	30	50	30	30	0																																																																																																																																																																																																																																			
		床	10			10		10	0																																																																																																																																																																																																																																			
0.60	J	0.52	0.40	0.34	0.39	0.33	0.33	0.26																																																																																																																																																																																																																																				
0.80	I	0.59	0.49	0.41	0.47	0.40	0.39	0.37																																																																																																																																																																																																																																				
1.00	H	0.66	0.57	0.49	0.55	0.48	0.47	0.44																																																																																																																																																																																																																																				
1.25	G	0.73	0.63	0.57	0.61	0.56	0.55	0.51																																																																																																																																																																																																																																				
1.50	F	0.76	0.68	0.61	0.66	0.60	0.58	0.56																																																																																																																																																																																																																																				
2.00	E	0.81	0.75	0.69	0.73	0.68	0.66	0.63																																																																																																																																																																																																																																				
2.50	D	0.85	0.79	0.75	0.77	0.73	0.71	0.67																																																																																																																																																																																																																																				
3.00	C	0.88	0.83	0.78	0.80	0.76	0.75	0.72																																																																																																																																																																																																																																				
4.00	B	0.91	0.87	0.83	0.84	0.81	0.79	0.78																																																																																																																																																																																																																																				
5.00	A	0.93	0.90	0.86	0.87	0.84	0.82	0.81																																																																																																																																																																																																																																				

P38

規格値の訂正-3

LRS1-33,49,65

最大器具 取付間隔 (Lm)	反射率 (%) 室指数	天井	70			50		30	0
		壁	70	50	30	50	30	30	0
		床	10			10		10	0
Lm=1.00H	0.60	J	0.59	0.50	0.44	0.49	0.43	0.43	0.42
	0.80	I	0.67	0.58	0.53	0.57	0.52	0.51	0.49
	1.00	H	0.74	0.66	0.60	0.65	0.59	0.58	0.57
	1.25	G	0.80	0.74	0.68	0.72	0.67	0.66	0.65
	1.50	F	0.83	0.76	0.72	0.76	0.71	0.70	0.69
	2.00	E	0.88	0.82	0.78	0.80	0.77	0.76	0.75
	2.50	D	0.91	0.86	0.83	0.85	0.81	0.80	0.79
	3.00	C	0.93	0.89	0.85	0.87	0.84	0.83	0.82
	4.00	B	0.95	0.92	0.89	0.90	0.88	0.86	0.85
	5.00	A	0.96	0.94	0.92	0.92	0.90	0.88	0.87

LRS1-33,49,65

反射率 (%) 室指数	天井	70			50		30	0
	壁	70	50	30	50	30	30	0
	床	10			10		10	0
0.60	J	0.59	0.50	0.44	0.49	0.43	0.43	0.41
0.80	I	0.67	0.58	0.53	0.57	0.52	0.51	0.49
1.00	H	0.74	0.66	0.60	0.65	0.59	0.58	0.57
1.25	G	0.80	0.74	0.68	0.72	0.67	0.66	0.65
1.50	F	0.83	0.76	0.72	0.76	0.71	0.70	0.69
2.00	E	0.88	0.82	0.78	0.80	0.77	0.76	0.75
2.50	D	0.91	0.86	0.83	0.85	0.81	0.80	0.79
3.00	C	0.93	0.89	0.85	0.87	0.84	0.83	0.82
4.00	B	0.95	0.92	0.89	0.90	0.88	0.86	0.85
5.00	A	0.96	0.94	0.92	0.92	0.90	0.88	0.87

P41





規格値の訂正-4

LRS17-05-30K
LRS17-05-40K

最大器具 取付間隔 (Lm)	反射率 (%) 室指数	天井	70			50		30	0
		壁	70	50	30	50	30	30	0
		床	10			10		10	0
Lm=1.00H	0.60	J	0.54	0.44	0.38	0.43	0.38	0.37	0.35
	0.80	I	0.61	0.52	0.45	0.50	0.45	0.44	0.43
	1.00	H	0.67	0.59	0.53	0.57	0.52	0.51	0.50
	1.25	G	0.74	0.66	0.60	0.64	0.60	0.59	0.58
	1.50	F	0.76	0.70	0.64	0.68	0.63	0.63	0.62
	2.00	E	0.81	0.76	0.72	0.75	0.70	0.69	0.68
	2.50	D	0.84	0.80	0.76	0.78	0.76	0.74	0.73
	3.00	C	0.87	0.82	0.79	0.81	0.78	0.76	0.75
	4.00	B	0.89	0.86	0.83	0.84	0.81	0.80	0.79
	5.00	A	0.91	0.88	0.86	0.86	0.84	0.82	0.81

LRS17-05-30K
LRS17-05-40K

反射率 (%) 室指数	天井	70			50		30	0
	壁	70	50	30	50	30	30	0
	床	10			10		10	0
0.60	J	0.54	0.44	0.38	0.43	0.38	0.37	0.31
0.80	I	0.61	0.52	0.45	0.50	0.45	0.44	0.41
1.00	H	0.67	0.59	0.53	0.57	0.52	0.51	0.47
1.25	G	0.74	0.66	0.60	0.64	0.60	0.59	0.54
1.50	F	0.76	0.70	0.64	0.68	0.63	0.63	0.59
2.00	E	0.81	0.76	0.72	0.75	0.70	0.69	0.68
2.50	D	0.84	0.80	0.76	0.78	0.76	0.74	0.73
3.00	C	0.87	0.82	0.79	0.81	0.78	0.76	0.75
4.00	B	0.89	0.86	0.83	0.84	0.81	0.80	0.79
5.00	A	0.91	0.88	0.86	0.86	0.84	0.82	0.81

P39 ～P40	表 A.5－LED 照明器具 の最大器具取付間隔及 び固有照明率（続き） 確認外の記載追加	LRS11R-17 LRS12-21,33,49 確認外 記載なし LRS11R-17  附属書B－図B.30 LRS12-21  附属書B－図B.31 LRS12-33 LRS12-49  附属書B－図B.31	LRS11R-17 LRS12-21,33,49 確認外 記載あり LRS11R-17  → 確認外 附属書B－図B.30 LRS12-21  → 確認外 附属書B－図B.31 LRS12-33 LRS12-49  → 確認外 附属書B－図B.31
---------------------	---	--	---

P64


附属書 図 B.16
形式記号の訂正-1
(SR→RS)

LSR28

LRS28


図 B.16

LSR28
確認外

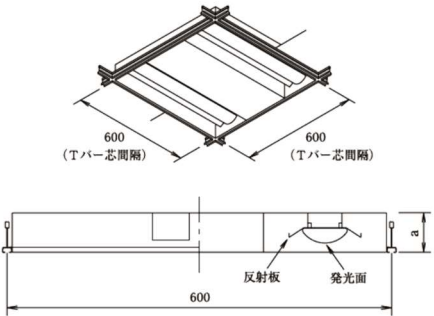

器 種	光 束 (lm)	消費 電力 (W)	入力 容量 (VA)	固有 エネルギー 消費効率 (lm/W)	定格 入力 電圧 (V)	寸法(mm)		材 質			制御 装置 の種類	グレア 分類
						a	本 体	反射板	発光面			
LSR28-6-30	3000 以上 4600 未満	33 以下	38 以下	125 以上	AC 100 V 242	90 以下	SPC	SPC	PC PMMA	LX LC※1		G1b
LSR28-6-46	4600 以上 7000 未満	45 以下	52 以下									

(簡 要) 1. グリッドシステム天井用とする。
2. ※1 LCに対応した器種一覧は、図B.39による。
3. LRS28-6-30は1800×1800に1台、LRS28-6-46は1800×2400に1台の取付を基本配置とする。

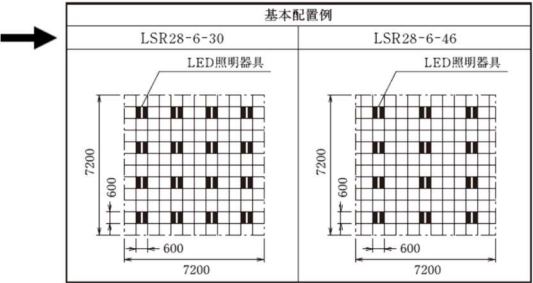

LRS28-6-30

LRS28-6-46

P65


附属書 図 B.17
形式記号の訂正-2
(SR→RS)

LSR29

LRS29


図 B.17

LSR29
確認外

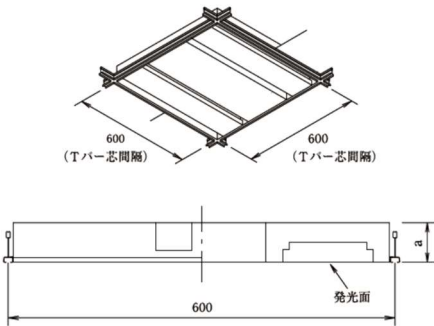

器 種	光 束 (lm)	消費 電力 (W)	入力 容量 (VA)	固有 エネルギー 消費効率 (lm/W)	定格 入力 電圧 (V)	寸法(mm)		材 質		制御 装置 の種類	グレア 分類
						a	本 体	発光面			
LSR29-6-28	2800 以上 4300 未満	35 以下	41 以下	120 以上	AC 100 V 242	90	SPC	PC PMMA	LX LC※1		G1b
LSR29-6-43	4300 以上 6600 未満	47 以下	55 以下								

(摘要) 1. グリッドシステム天井用とする。
2. ※1 LCに対応した器種一覧は、図B.39による。
3. LRS29-6-28は1800×1800に1台、LSR29-6-43は1800×2400に1台の取付を基本配置とする。

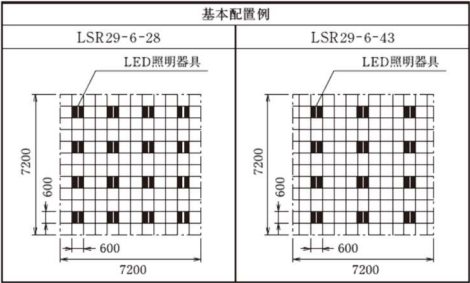

LRS29-6-28

LRS29-6-43